

www.hilti.com

Company:		Page:	1
Address:		Specifier:	
Phone Fax:		E-Mail:	
Design:	CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date:	6/13/2023
Fastening point:			


Specifier's comments:

1 Input data

Anchor type and diameter:	AWS D1.1 GR. B 7/8
Item number:	not available
Effective embedment depth:	$h_{ef} = 8.000$ in.
Material:	
Evaluation Service Report:	Hilti Technical Data
Issued Valid:	- -
Proof:	Design Method ACI 318-19 / CIP
Stand-off installation:	$e_b = 0.000$ in. (no stand-off); $t = 0.500$ in.
Anchor plate ^R :	$l_x \times l_y \times t = 7.500$ in. x 13.000 in. x 0.500 in.; (Recommended plate thickness: not calculated)
Profile:	Rectangular HSS (AISC), HSS7X3X.500; (L x W x T) = 7.000 in. x 3.000 in. x 0.500 in.
Base material:	cracked concrete, 4000, $f'_c = 4,000$ psi; $h = 12.000$ in.
Reinforcement:	tension: present, shear: present; anchor reinforcement: tension edge reinforcement: > No. 4 bar with stirrups
Seismic loads (cat. C, D, E, or F)	Tension load: yes (17.10.5.3 (d)) Shear load: yes (17.10.6.3 (c))

^R - The anchor calculation is based on a rigid anchor plate assumption.

Geometry [in.] & Loading [lb, in.lb]

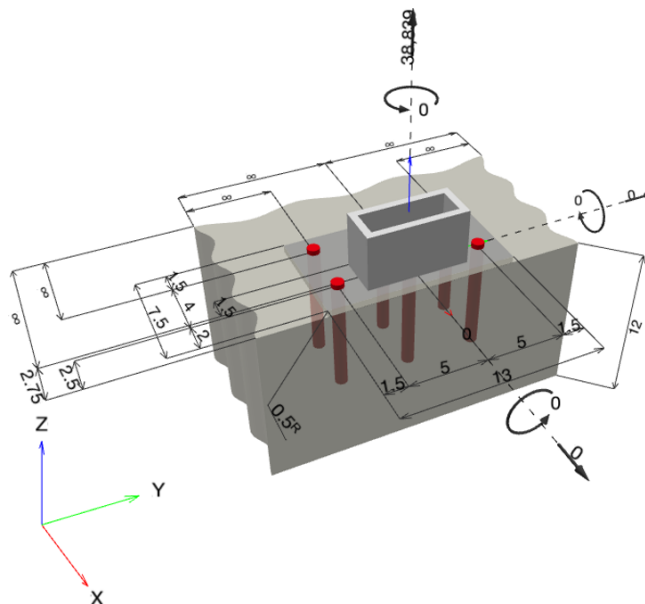

www.hilti.com

Company:	Page: 2
Address:	Specifier:
Phone Fax:	E-Mail:
Design: CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date: 6/13/2023
Fastening point:	

1.1 Design results


Case	Description	Forces [lb] / Moments [in.lb]	Seismic	Max. Util. Anchor [%]
1	Combination 1	N = 38,839; V _x = 0; V _y = 0; M _x = 0; M _y = 0; M _z = 0;	yes	160

2 Load case/Resulting anchor forces

Anchor reactions [lb]

Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	11,888	0	0	0
2	11,888	0	0	0
3	11,888	0	0	0
4	1,858	0	0	0
5	1,858	0	0	0
6	1,858	0	0	0

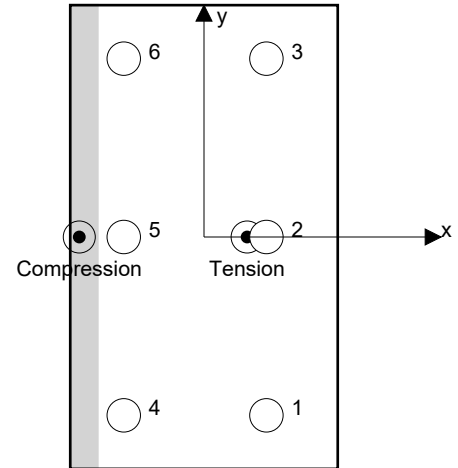

max. concrete compressive strain: 0.11 [‰]
 max. concrete compressive stress: 486 [psi]
 resulting tension force in (x/y)=(1.209/-0.000): 41,238 [lb]
 resulting compression force in (x/y)=(-3.497/0.000): 2,399 [lb]

Anchor forces are calculated based on the assumption of a rigid anchor plate.

3 Tension load

	Load N _{ua} [lb]	Capacity ϕN_n [lb]	Utilization $\beta_N = N_{ua} / \phi N_n$	Status
Steel Strength*	11,888	29,299	41	OK
Pullout Strength*	11,888	14,851	81	OK
Concrete Breakout Failure** ¹	N/A	N/A	N/A	N/A
Concrete Side-Face Blowout, direction x+**	35,664	22,299	160	not recommended

* highest loaded anchor **anchor group (anchors in tension)

¹ Tension Anchor Reinforcement has been selected!



www.hilti.com

Company:		Page:	3
Address:		Specifier:	
Phone Fax:		E-Mail:	
Design:	CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date:	6/13/2023
Fastening point:			

3.1 Steel Strength

$N_{sa} = A_{se,N} f_{uta}$ ACI 318-19 Eq. (17.6.1.2)
 $\phi N_{sa} \geq N_{ua}$ ACI 318-19 Table 17.5.2

Variables

$A_{se,N}$ [in. ²]	f_{uta} [psi]
0.59	65,000

Calculations

N_{sa} [lb]
39,065

Results

N_{sa} [lb]	ϕ_{steel}	ϕN_{sa} [lb]	N_{ua} [lb]
39,065	0.750	29,299	11,888

3.2 Pullout Strength

$N_{pN} = \psi_{c,p} N_p$ ACI 318-19 Eq. (17.6.3.1)
 $N_p = 8 A_{brg} f'_c$ ACI 318-19 Eq. (17.6.3.2.2a)
 $\phi N_{pN} \geq N_{ua}$ ACI 318-19 Table 17.5.2

Variables

$\psi_{c,p}$	A_{brg} [in. ²]	λ_a	f'_c [psi]
1.000	0.88	1.000	4,000

Calculations

N_p [lb]
28,288

Results

N_{pn} [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	ϕN_{pn} [lb]	N_{ua} [lb]
28,288	0.700	0.750	1.000	14,851	11,888



www.hilti.com

Company:		Page:	4
Address:		Specifier:	
Phone Fax:		E-Mail:	
Design:	CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date:	6/13/2023
Fastening point:			

3.3 Concrete Side-Face Blowout, direction x+

$$N_{sb} = 160 c_{a1} \sqrt{A_{brg}} \lambda_a \sqrt{f'_c} \quad \text{ACI 318-19 Eq. (17.6.4.1)}$$

$$N_{sbg} = \alpha_{group} N_{sb} \quad \text{ACI 318-19 Eq. (17.6.4.2)}$$

$$\phi N_{sbg} \geq N_{ua} \quad \text{ACI 318-19 Table 17.5.2}$$

$$\alpha_{group} = \left(1 + \frac{s}{6 c_{a1}} \right) \quad \text{see ACI 318-19, Section 17.6.4.2, Eq. (17.6.4.2)}$$

Variables

c_{a1} [in.]	c_{a2} [in.]	A_{brg} [in. ²]	λ_a	f'_c [psi]	s [in.]
2.500	-	0.88	1.000	4,000	10.000

Calculations

α_{group}	N_{sb} [lb]
1.667	23,786

Results

N_{sbg} [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	ϕN_{sbg} [lb]	$N_{ua,edge}$ [lb]
39,643	0.750	0.750	1.000	22,299	35,664



www.hilti.com

Company:		Page:	5
Address:		Specifier:	
Phone Fax:		E-Mail:	
Design:	CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date:	6/13/2023
Fastening point:			

4 Shear load

	Load V_{ua} [lb]	Capacity ϕV_n [lb]	Utilization $\beta_v = V_{ua} / \phi V_n$	Status
Steel Strength*	N/A	N/A	N/A	N/A
Steel failure (with lever arm)*	N/A	N/A	N/A	N/A
Pryout Strength*	N/A	N/A	N/A	N/A
Concrete edge failure in direction **	N/A	N/A	N/A	N/A

* highest loaded anchor **anchor group (relevant anchors)

5 Warnings

- The anchor design methods in PROFIS Engineering require rigid anchor plates per current regulations (AS 5216:2021, ETAG 001/Annex C, EOTA TR029 etc.). This means load re-distribution on the anchors due to elastic deformations of the anchor plate are not considered - the anchor plate is assumed to be sufficiently stiff, in order not to be deformed when subjected to the design loading. PROFIS Engineering calculates the minimum required anchor plate thickness with CBFEM to limit the stress of the anchor plate based on the assumptions explained above. The proof if the rigid anchor plate assumption is valid is not carried out by PROFIS Engineering. Input data and results must be checked for agreement with the existing conditions and for plausibility!
- Condition A applies where the potential concrete failure surfaces are crossed by supplementary reinforcement proportioned to tie the potential concrete failure prism into the structural member. Condition B applies where such supplementary reinforcement is not provided, or where pullout or pryout strength governs.
- For additional information about ACI 318 strength design provisions, please go to <https://submittals.us.hilti.com/PROFISAnchorDesignGuide/>
- "An anchor design approach for structures assigned to Seismic Design Category C, D, E or F is given in ACI 318-19, Chapter 17, Section 17.10.5.3 (a) that requires the governing design strength of an anchor or group of anchors be limited by ductile steel failure. If this is NOT the case, the connection design (tension) shall satisfy the provisions of Section 17.10.5.3 (b), Section 17.10.5.3 (c), or Section 17.10.5.3 (d). The connection design (shear) shall satisfy the provisions of Section 17.10.6.3 (a), Section 17.10.6.3 (b), or Section 17.10.6.3 (c)."
- Section 17.10.5.3 (b) / Section 17.10.6.3 (a) require the attachment the anchors are connecting to the structure be designed to undergo ductile yielding at a load level corresponding to anchor forces no greater than the controlling design strength. Section 17.10.5.3 (c) / Section 17.10.6.3 (b) waive the ductility requirements and require the anchors to be designed for the maximum tension / shear that can be transmitted to the anchors by a non-yielding attachment. Section 17.10.5.3 (d) / Section 17.10.6.3 (c) waive the ductility requirements and require the design strength of the anchors to equal or exceed the maximum tension / shear obtained from design load combinations that include E, with E increased by ω_0 .
- The design of Anchor Reinforcement is beyond the scope of PROFIS Engineering. Refer to ACI 318-19, Section 17.5.2.1 (a) for information about Anchor Reinforcement.
- Anchor Reinforcement has been selected as a design option, calculations should be compared with PROFIS Engineering calculations.

Fastening does not meet the design criteria!

www.hilti.com

Company:	Page: 6
Address:	Specifier:
Phone Fax:	E-Mail:
Design: CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date: 6/13/2023
Fastening point:	

6 Installation data

Profile: Rectangular HSS (AISC), HSS7X3X.500; (L x W x T) = 7.000 in. x 3.000 in. x 0.500 in.

Hole diameter in the fixture: $d_f = 0.938$ in.

Plate thickness (input): 0.500 in.

Recommended plate thickness: not calculated

Anchor type and diameter: AWS D1.1 GR. B 7/8

Item number: not available


Maximum installation torque: -

Hole diameter in the base material: - in.

Hole depth in the base material: 8.000 in.

Minimum thickness of the base material: 8.875 in.

Hilti AWS welded headed stud anchor with 8 in embedment, 7/8, Steel galvanized, installation per instruction for use

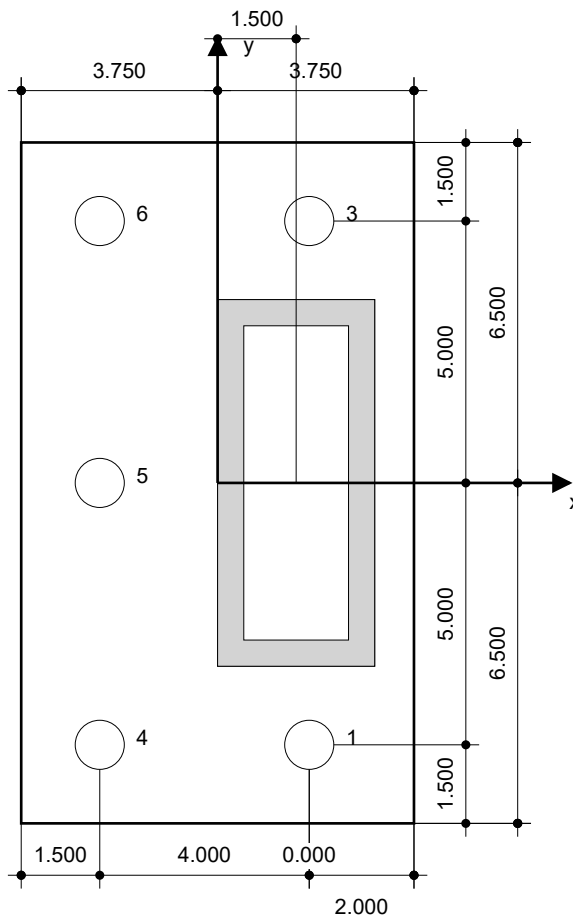

Coordinates Anchor [in.]

Anchor	x	y	C _{-x}	C _{+x}	C _{-y}	C _{+y}	Anchor	x	y	C _{-x}	C _{+x}	C _{-y}	C _{+y}
1	1.750	-5.000	-	2.500	-	-	4	-2.250	-5.000	-	6.500	-	-
2	1.750	0.000	-	2.500	-	-	5	-2.250	0.000	-	6.500	-	-
3	1.750	5.000	-	2.500	-	-	6	-2.250	5.000	-	6.500	-	-

Input data and results must be checked for conformity with the existing conditions and for plausibility!
 PROFIS Engineering (c) 2003-2023 Hilti AG, FL-9494 Schaan Hilti is a registered Trademark of Hilti AG, Schaan



www.hilti.com

Company:		Page:	7
Address:		Specifier:	
Phone Fax:		E-Mail:	
Design:	CIA-SAHA CAST IN PLACE EMBED FOR COLUMN	Date:	6/13/2023
Fastening point:			

7 Remarks; Your Cooperation Duties

- Any and all information and data contained in the Software concern solely the use of Hilti products and are based on the principles, formulas and security regulations in accordance with Hilti's technical directions and operating, mounting and assembly instructions, etc., that must be strictly complied with by the user. All figures contained therein are average figures, and therefore use-specific tests are to be conducted prior to using the relevant Hilti product. The results of the calculations carried out by means of the Software are based essentially on the data you put in. Therefore, you bear the sole responsibility for the absence of errors, the completeness and the relevance of the data to be put in by you. Moreover, you bear sole responsibility for having the results of the calculation checked and cleared by an expert, particularly with regard to compliance with applicable norms and permits, prior to using them for your specific facility. The Software serves only as an aid to interpret norms and permits without any guarantee as to the absence of errors, the correctness and the relevance of the results or suitability for a specific application.
- You must take all necessary and reasonable steps to prevent or limit damage caused by the Software. In particular, you must arrange for the regular backup of programs and data and, if applicable, carry out the updates of the Software offered by Hilti on a regular basis. If you do not use the AutoUpdate function of the Software, you must ensure that you are using the current and thus up-to-date version of the Software in each case by carrying out manual updates via the Hilti Website. Hilti will not be liable for consequences, such as the recovery of lost or damaged data or programs, arising from a culpable breach of duty by you.